


(Below Ground Installation)



STANDARD LENGTHS OF WIRES = 15  
FEET. OPTIONAL LENGTHS PER  
CUSTOMER SPECIFICATIONS.


Wire No. In (AWG)

(Type "AA" Test Box)



STANDARD LENGTHS OF WIRES = 15 FEET. OPTIONAL LENGTHS PER CUSTOMER SPECIFICATIONS.

## Curb The Electrical Breakdown of Insulated Flanges

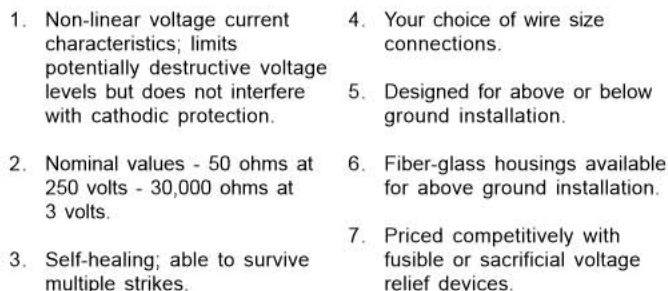


**Consult Factory for Details**

## STANDARD SIZES

Length x Height x Width

1. Ideal housing for Barlow "TMK"  
Surge Arrestors, Lightning Arrestors,  
terminal wiring boxes and electrical  
control enclosures in highly corrosive atmospheres.
2. These enclosures are molded from a special polyester  
resin material which has excellent resistance and out-  
standing physical properties. The hinged cover is easily  
removable, and is attached to the body with internal  
hinges. Each cover has a neoprene gasket attached with  
oil-resistant adhesive. Cover screws are monel. All  
enclosures have a grey finish inside and out.
3. Drill holes, cut outs, floor flanges can be supplied at  
an extra charge.
4. These enclosures conform to the NEMA 4 standards for:  
dusttight, raintight, sleet-ice-resistant, rain-proof, water-tight,  
oil-tight and corrosion-resistant.

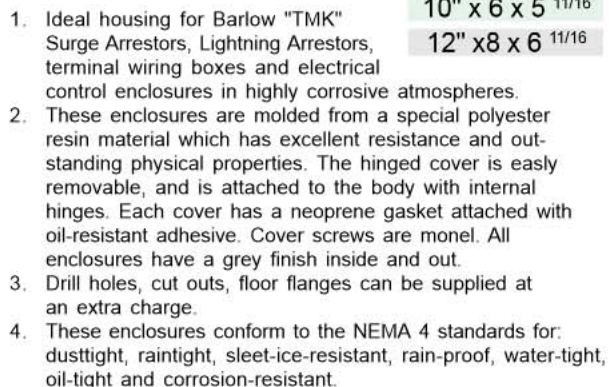

**IMAC SYSTEMS, INC.**

P.O. BOX 1605 • TULLYTOWN, PA 19007

1-800-955-4GAS (4427) • Tel: (215) 946-2200 • FAX: (215) 943-2984

e-mail: [sales@imacsystems.com](mailto:sales@imacsystems.com)